
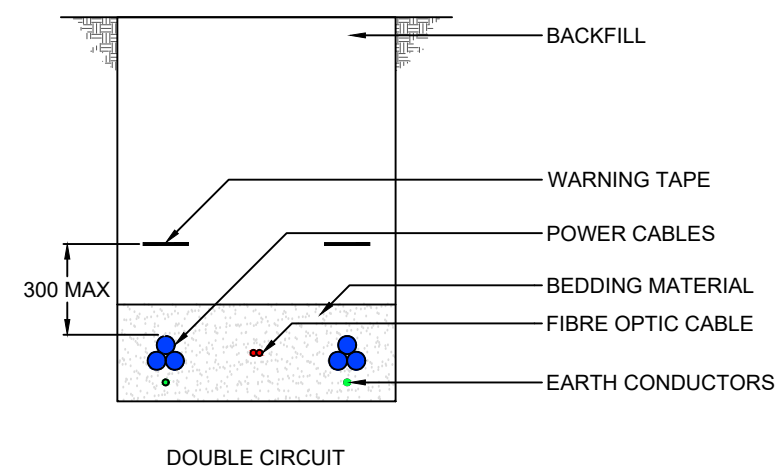


**DUNBEG SOUTH EXTENSION  
WIND FARM**

**FIGURE 1.13**



**CROSS SECTION OF  
UNDERGROUND  
CABLE TRENCH**

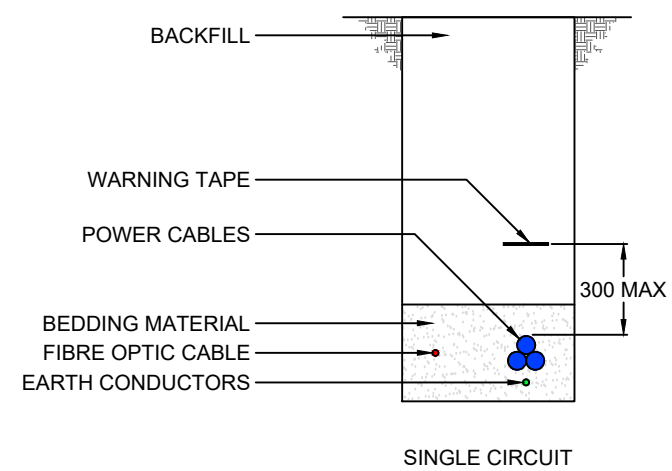

TYPICAL CABLE TRENCHES

**NOTES:**

1. THIS DRAWING IS INDICATIVE ONLY AND IS SUBJECT TO CHANGE AT THE DETAILED DESIGN STAGE.
2. ALL DIMENSIONS IN mm.
3. CABLES MAY BE INSTALLED BY CABLE PLOUGH FOR DISTANCES GREATER THAN 1km.

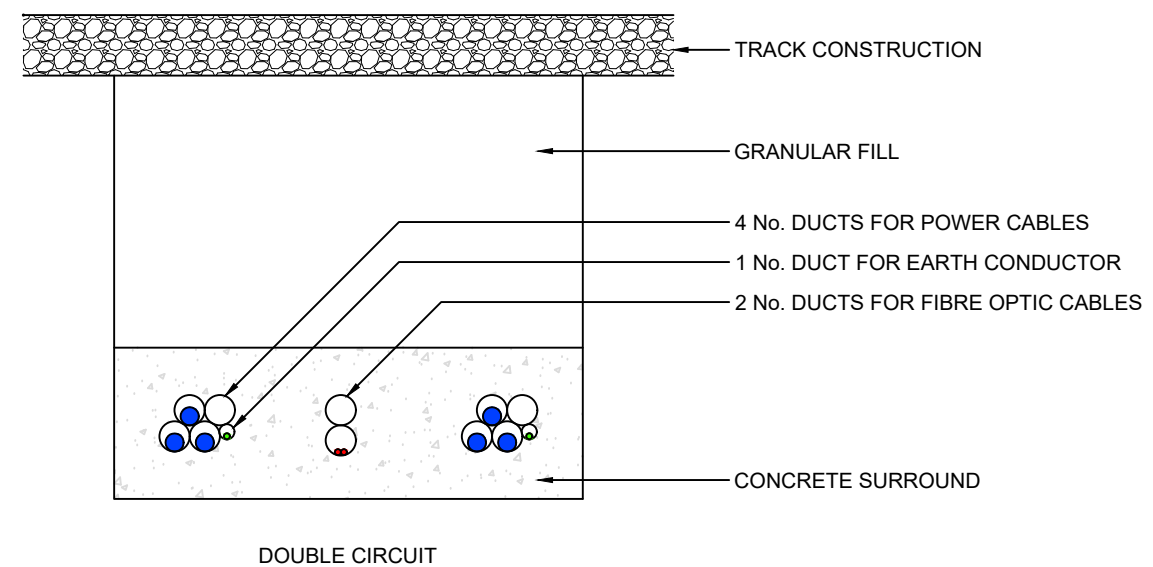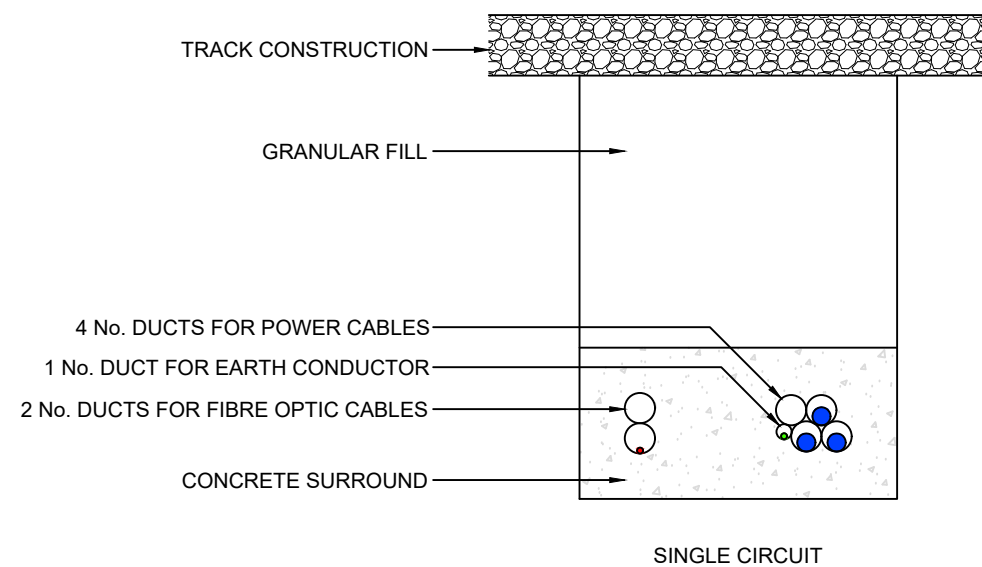

TYPICAL TRACK CROSSINGS

LAYOUT DWG	N/A	T-LAYOUT NO.	N/A
------------	-----	--------------	-----

DRAWING NUMBER	05214-RES-CBL-DR-EE-001	REV	1
----------------	-------------------------	-----	---

SCALE - NOT TO SCALE

ENVIRONMENTAL STATEMENT  
2024

THIS DRAWING IS THE PROPERTY OF RENEWABLE ENERGY SYSTEMS LTD. AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION